

GENERAL INFORMATION

- 1) A qualified electrician, in accordance with IEE wiring regulations should carry out connection to mains wiring.
- 2) This unit must be EARTHED.
- 3) Ensure that the rated voltage and frequency requirements are compatible with the available mains supply.
- 4) Do not carry out high voltage insulation test, i.e. 500/1000v this may damage internal components.
- 5) Switch off mains power supply before installing.

SPECIFICATIONS

Code	M6Y14K	M6Y13K
Output	2500 lumens	2325 lumens
Power	21W	21W
Colour Temperature	4000K	3000K
Ra	>80	>80
Weight	2.3kg	2.3kg
Height	147mm	147mm
Distribution pattern	Wide beam	Wide beam
Colour	Anthracite grey	Anthracite grey
Body	Die cast aluminium	Die cast aluminium
Bezel	Die cast aluminium	Die cast aluminium
Diffuser	PMMA	PMMA

Mirage LED IP65



TECHNICAL SUPPORT

Tel: 0161 331 5700

e-mail: technical@whitecroftlight.com
www.whitecroftlighting.com

May 2019 - Rev A





Whitecroft Lighting Limited

Burlington Street, Ashton-under-Lyne, Lancashire OL7 0AX
 Telephone +44 (0)870 5 087 087 Facsimile: +44 (0)870 5 084 210

Registered No. 3848973 England

Registered Office: As above

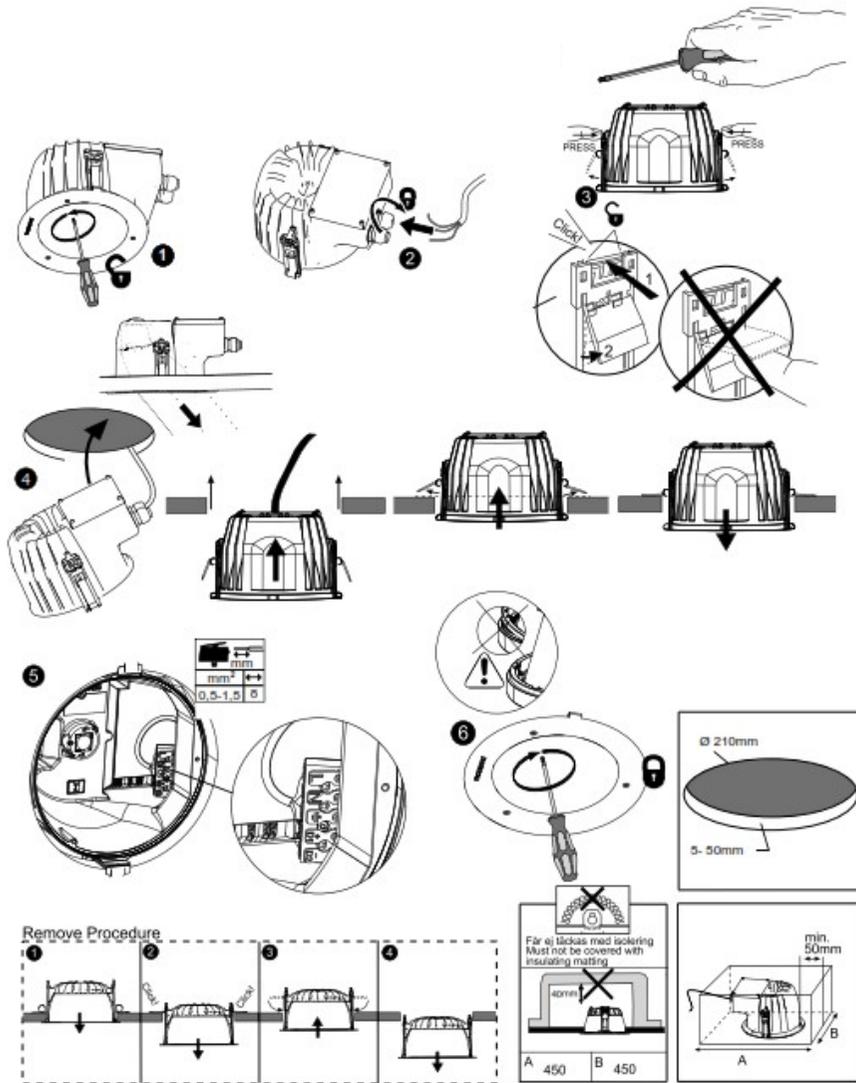

S Grundläggande isolering mellan nät och styr ledning.
GB Basic insulation between mains and control wiring.

S För montering i ventilerat alternativt oventilerat utrymme.
GB For mounting in ventilated or unventilated space

S Det är lämpligt att denna information överlämnas till användaren av anläggningen.
D Diese Informationen sind für den Benutzer der Anlage vorgesehen.

GB It is appropriate that this information is passed on to the users of the installation.
SF Nämä ohjeet tulee säilyttää ja luovuttaa kiinteistön käyttäjälle.

Ljuskällan ska endast bytas ut av tillverkaren eller hans utsedd person.
The light source shall only be replaced by the manufacturer or his designated person.